

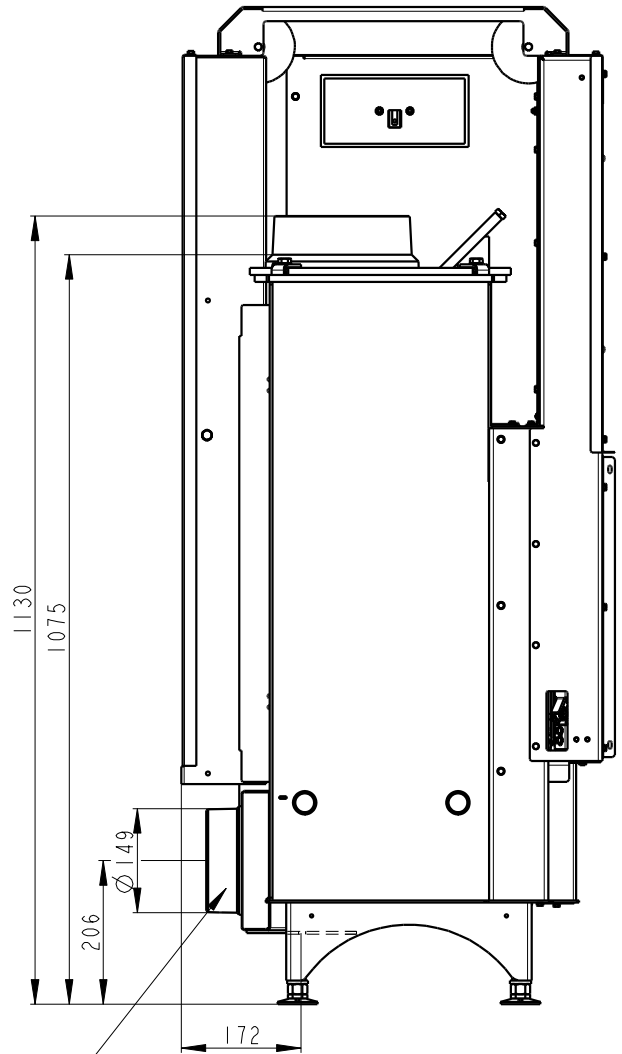
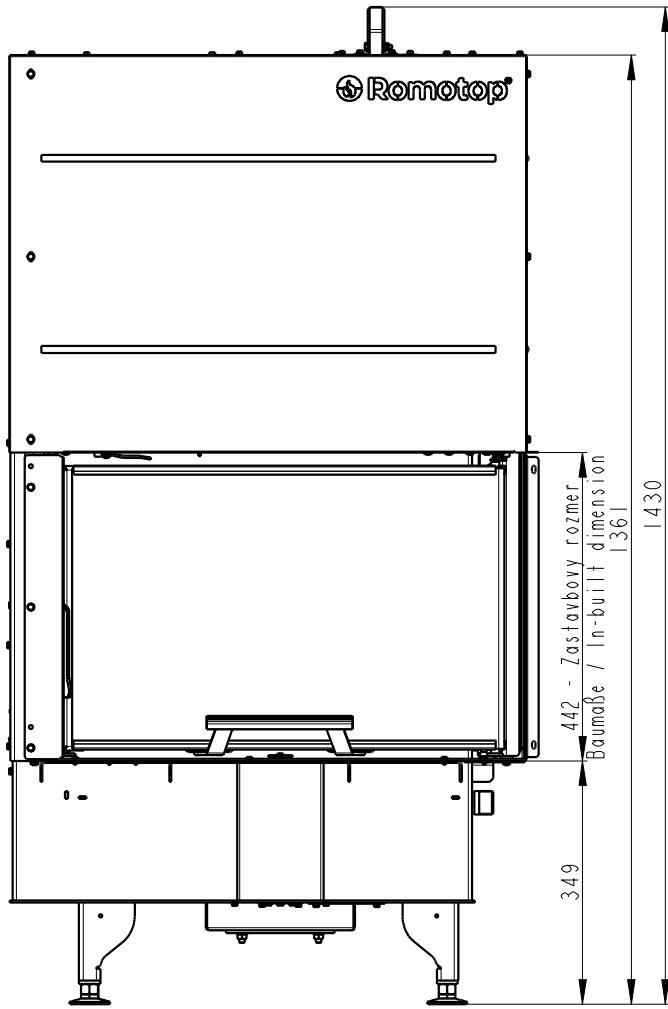


ANGLE R 2G L 66.44.44.01(03,05)

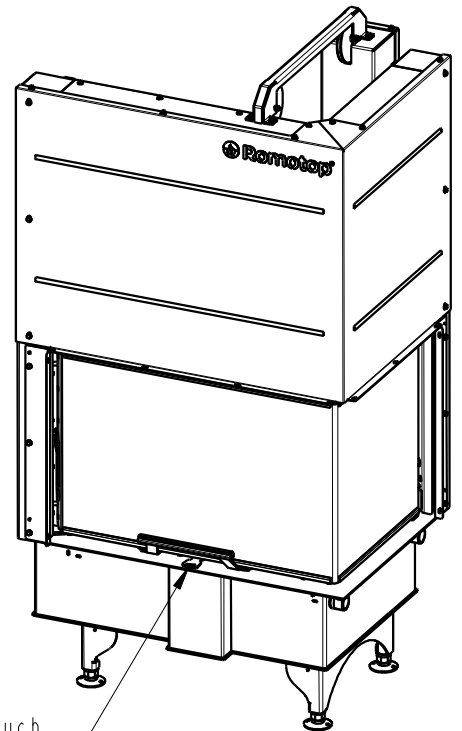

Centralni privod vazduhu
 Central air inlet
 Zentralluftzufuhr

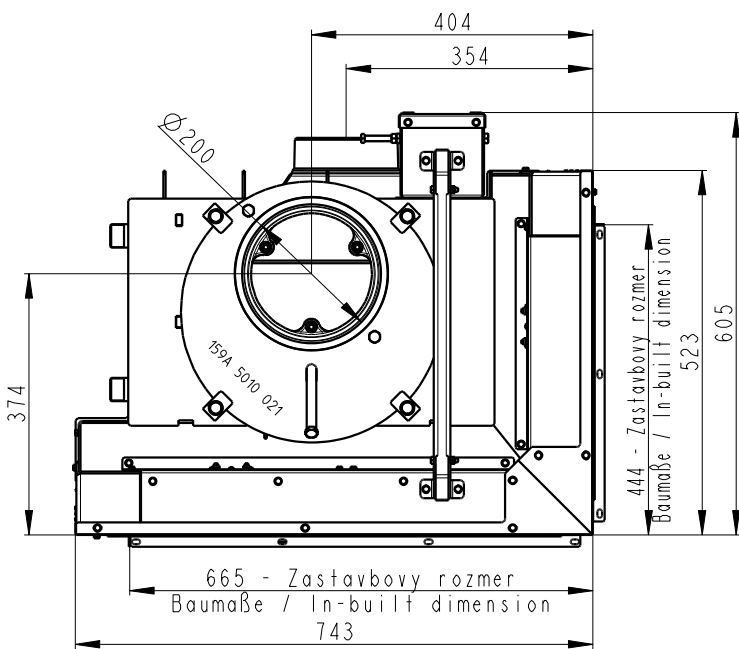

Primarni a sekundarni vazduh
 Primärluft und Sekundärluft
 Primary and secondary air

Artikl	AR2LE01(03,05)
--------	----------------

General data

Nominal heat output	kW	6,9
Efficiency	%	85
Mass of the test fuel fired hourly	kg/h	1,92
Dry flue gases mass flow	g/s	3,6
Mean flue gas temperature	°C	266
Flue draught	Pa	12
Weight	kg	260
CO ₂	%	11,84

Recommended values

Reg.output	kW	4-11
Max. mass of the test fuel fired hourly (max)	kg/h	4,5
Min. cross section of convect air inlet for nominal output	cm ²	880
Min. cross section of convect air outlet for nominal output	cm ²	1120
Combustion air requirement	m ³ /h	13,55
Flue gas connector diameter	mm	200



Meets requirement limit values for

EN 13 229	•
BImSch V 1	•
BImSch V 2	•
DIN plus	•
15a B-VG	•



Supplied accessories

Holder with magnet	•
Hook to open the ashtray	•
Ashtray	•

ANGLE L 2G L 66.44.44.01(03,05)

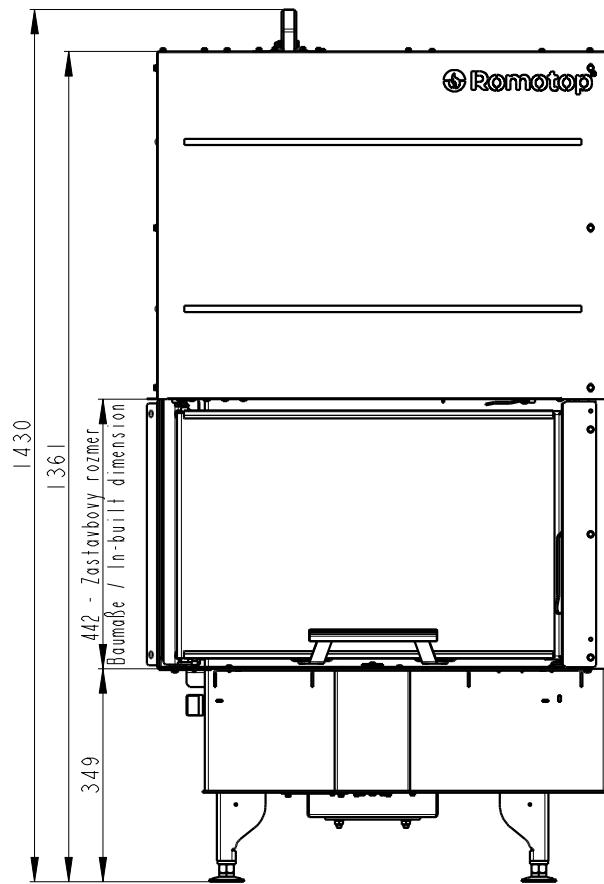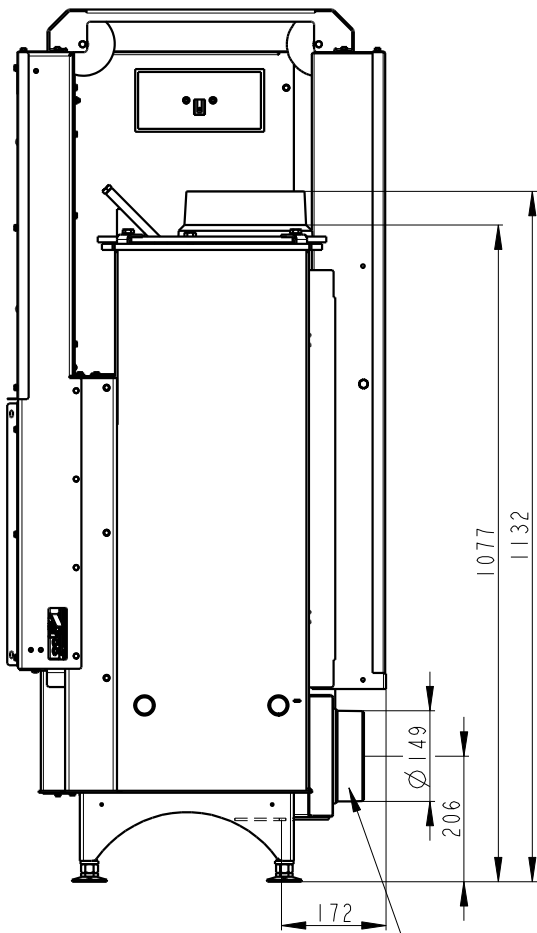

Centralni privod vzduchu
 Central air inlet
 Zentralluftzufuhr

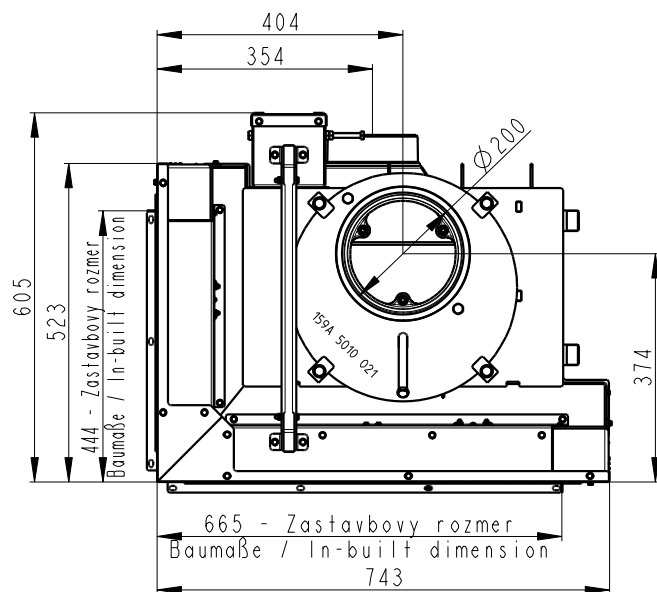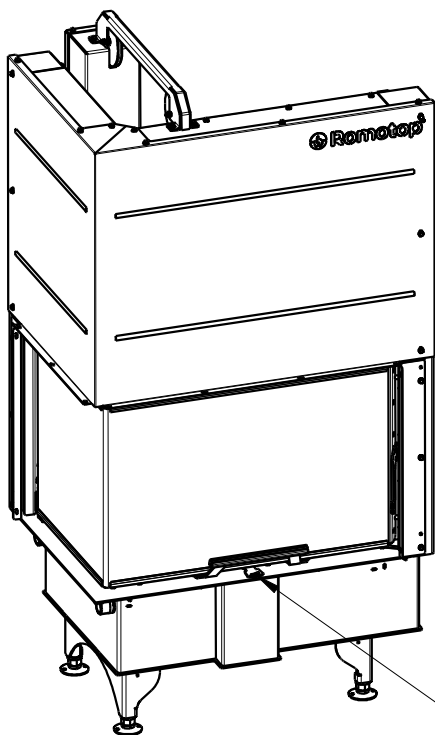

Primarni a sekundarni vzduch
 Primärluft und Sekundärluft
 Primary and secondary air

Artikl	AL2LE01(03,05)
--------	----------------

General data

Nominal heat output	kW	9
Efficiency	%	83
Mass of the test fuel fired hourly	kg/h	2,52
Dry flue gases mass flow	g/s	7,2
Mean flue gas temperature	°C	215
Flue draught	Pa	12
Weight	kg	255
CO ₂	%	10,21

Recommended values

Reg.output	kW	4-11
Max. mass of the test fuel fired hourly	kg/h	4,5
Min. cross section of convect air inlet for nominal output	cm ²	880
Min. cross section of convect air outlet for nominal output	cm ²	1120
Combustion air requirement	m ³ /h	13,55
Flue gas connector diameter	mm	200

Meets requirement limit values for

EN 13 229	•
BImSch V 1	•
BImSch V 2	•
DIN plus	•
15a B-VG	•

Supplied accessories

Holder with magnet	•
Hook to open the ashtray	•
Ashtray	•